




<https://fmac-co.wildapricot.org/>  
[secretaryfmac@gmail.com](mailto:secretaryfmac@gmail.com)



Generators – installed not less than 10 feet from combustibles and isolated by physical guard/fence or enclosure not less than 3 feet away from internal combustion power source. IFC 3106.6.2

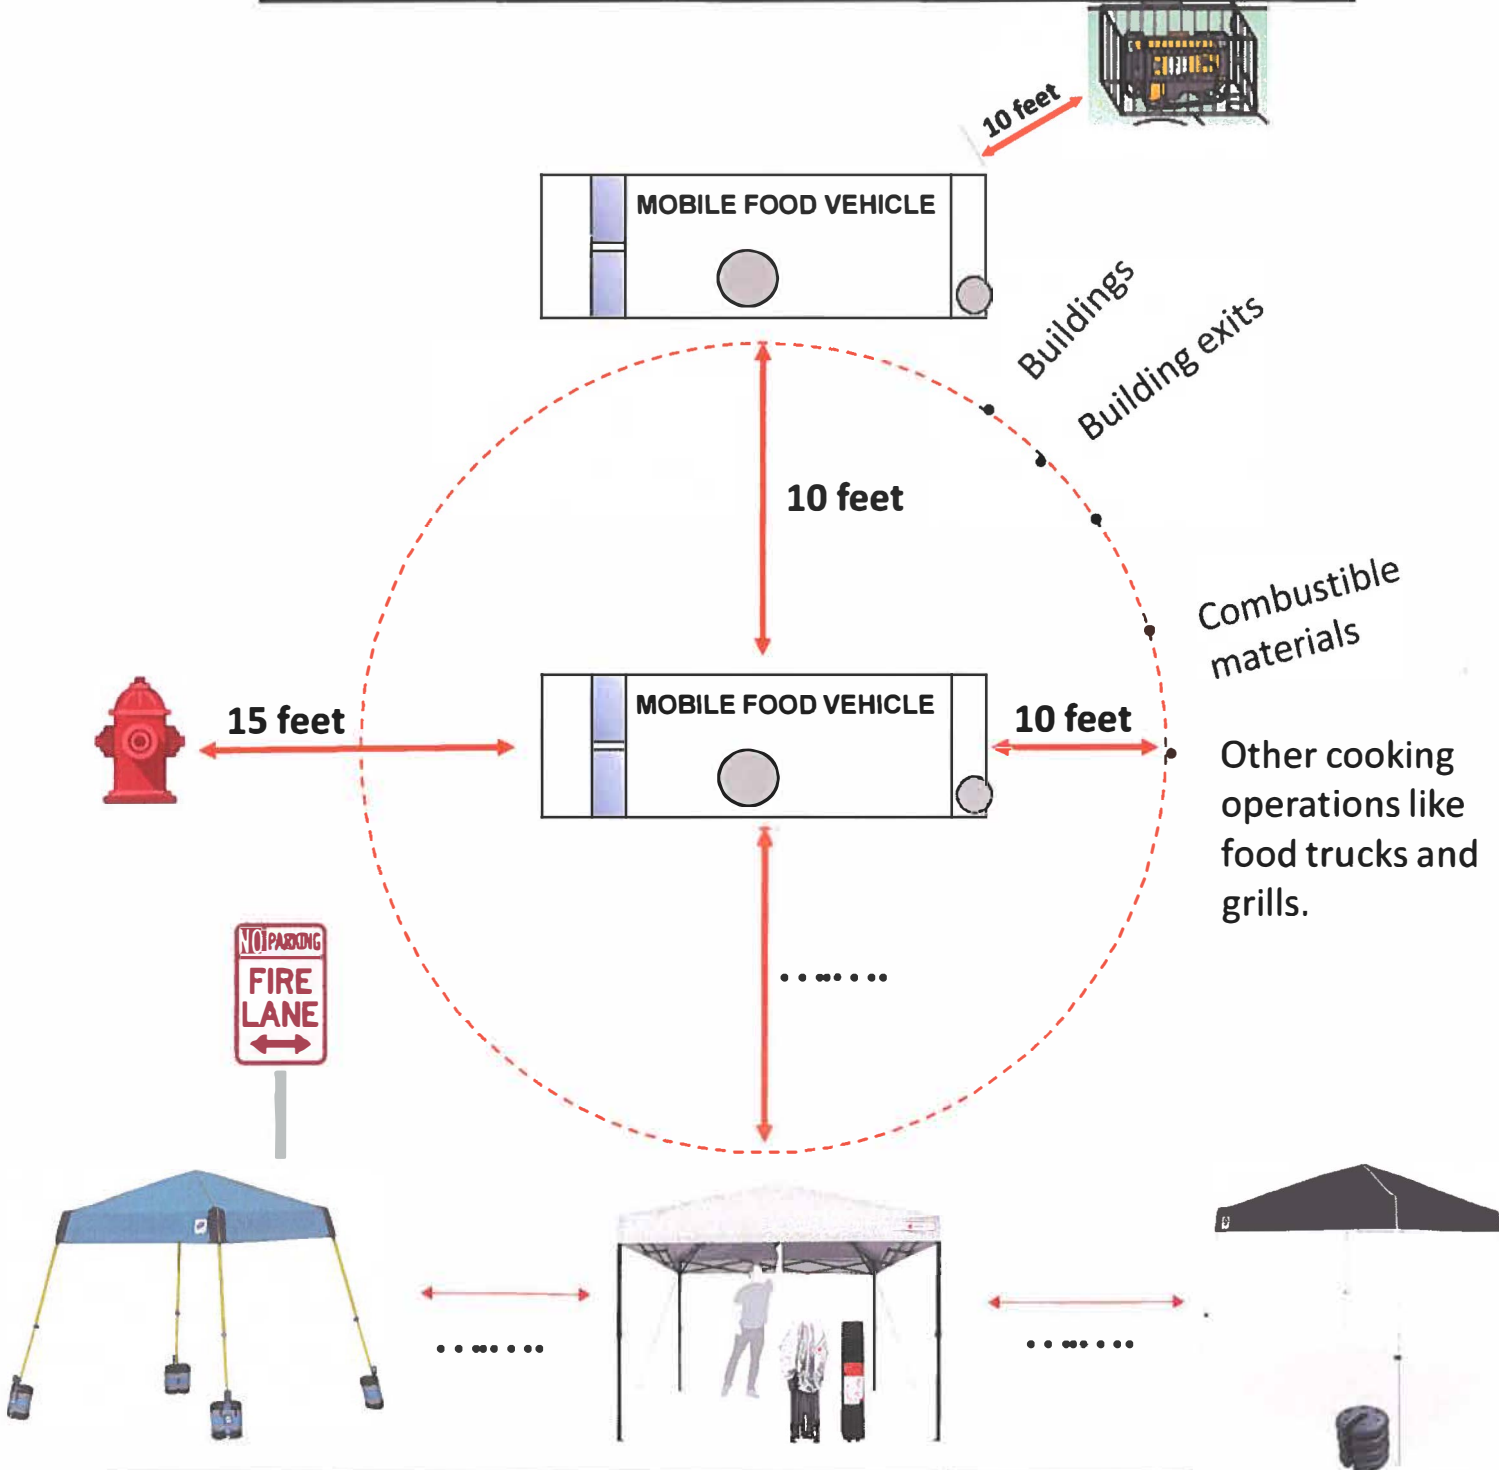

An unobstructed fire break passageway of not less than 12 ft wide and free from guy ropes or other obstructions shall be maintained on all sides of tent(s)/structures. IFC 3103.8.6

Structures and their appurtenances shall be adequately roped, braced and anchored to withstand the elements of weather and prevent against collapse. IFC 3103.9